


**PROFORMA REGARDING SAFE DRINKING WATER AND SANITARY CONDITION
CERTIFICATE.**

No. Gen/Certi/4/2/24

Date : 16/4/24

It is certified that an inspection team headed by DS - Sunil Patel
& team. (Name of Officers
with designation) from 12/4/24 (Name of
Department/Office) inspected the AADHARSHILA SCHOOL
VALAD, GANDHINAGAR (Name & Address of
the School) on _____ and found that the _____
AADHARSHILA SCHOOL (Name of school) has safe
drinking water facilities for the students and members of staff of the institution and is maintaining
the hygienic sanitation condition in the school building & the campus as per the norms
prescribed by the Central/State/U.T Govt.

The above valid for a period of ~~2 years~~
2 yrs
state

Signature with Seal : 


Name DS Sunil Patel

Designation : Medical Officer
PHC Vadodara
Ta. Dist. Gandhinagar

To

AADHARSHILA SCHOOL
VALAD
GANDHINAGAR

(Name & Address of the Institution)

x 
PRINCIPAL
AADHARSHILA SCHOOL
VALAD, GANDHINAGAR.

TEST REPORT

Page No. 1/2

Report No. GL/C./180813002
Sample Submitted By Aadharshila Education And Charitable Trust
N.H. NO : 8, AT & PO. VALAD
Ta : Gandhinagar Gandhinagar

Date of Receipt 13/08/2018
Reference No. NM

Sample Described as Gujarat Water

Batch No. NM
Mfg.Date NM
Exp.Date NM

Mode of Packing Sample Packed in Plastic Bottle
Sample Condition Satisfactory
Marking --

Sample Qty.: 1 Ltr

Analysis Date 13/08/2018

Report Date 18/08/2018

Sl. No.	Characteristics Examined	Requirement (Acceptable Limit)	Permissible Limit in abs. of Alternate source	Method of Test	Result	Quantification Limit
1	Colour Hazen Unit	Max. 5.0	Max.15.0	IS : 3025 (P-4) : 1983	1	1
2	Odour	Agreeable	Agreeable	IS : 3025 (P-5) : 1983	Agreeable	---
3	pH at 25 °C	6.5 to 8.5	No Relaxation	IS : 3025 (P-11): 1983	7.46	1
4	Taste	Agreeable	Agreeable	IS : 3025 (P-7 & 8) : 1984	Agreeable	---
5	Turbidity NTU	Max. 1.0	Max. 5.0	IS : 3025 (P-10): 1984	<0.1	0.1
6	Total Dissolved Solids mg/l	Max. 500	Max. 2000	IS : 3025 (P-16) : 1984	586	5
7	Calcium (as Ca) mg/l	Max. 75	Max. 200	IS : 3025 (P-40) : 1991	27.77	0.1
8	Chloride (as Cl) mg/l	Max. 250	Max. 1000	IS : 3025 (P-32) : 1988	63.66	0.5
9	Fluoride (as F) mg/l	Max. 1.0	Max. 1.5	IS : 3025 (P-60) : 2008	0.5	0.25
10	Magnesium (as Mg) mg/l	Max. 30	Max. 100	IS : 3025 (P-46): 1994	15.09	0.1
11	Nitrate (as NO3) mg/l	Max. 45	No Relaxation	IS : 3025 (P-34) : 1988	8.42	1
12	Phenolic Compounds (as C6H5CO) mg/l	Max. 0.001	Max. 0.002	IS : 3025 (P-43) : 1992	B.L.Q.	0.001
13	Sulphate (as SO4) mg/l	Max. 200	Max. 400	IS : 3025 (P-24) : 1986	25.10	0.5
14	Total Hardness (as CaCO3) mg/l	Max. 200	Max. 600	IS : 3025 (P-21) : 2009	132.30	1
15	Total Coliform per 100 ml	Shall not be Detectable	Shall not be Detectable	IS : 1622-1981	Not Detected	2 MPN
16	E.Coli per 100 ml	Shall not be Detectable	Shall not be Detectable	IS : 1622-1981	Not Detected	2 MPN

Conti....

Note :

- The Result refer only to the tested sample & applicable parameters, Endorsement of products is neither inferred nor implied.
- Total liability of our institution is limited to the invoice amount/testing charges.
- This report is not to be reproduced wholly or in part and cannot be used as an evidence in the court of law and should not be used in any advertising media without our special permission in writing.
- Sample drawn & submitted by the party for analysis unless otherwise stated.
- Gujarat Laboratory maintains strict confidentiality of all the analysis and test results and customer supplied product and will not reveal this information to third party unless required by the statutory or legal requirement.
- Subject to Ahmedabad Jurisdiction.
- Perishable samples will be destroyed after testing, others after three weeks from the date of issue of the report, unless otherwise agreed with the customer. Also retain sample will not be returned unless otherwise agreed in writing.
- The sample is accepted by us subject to our general conditions of services which is displayed at reception notice board & is also available on request.
- Attention is drawn to the limitation of liabilities; indemnification and jurisdictional issues etc defined therein.
- Customer requested for the above test only.

Testing Facilities for :

Food & Agriculture Products • Water & Waste Water • Pharmaceuticals • Microbiological • Environment • Fertilizer • Soil • Cosmetic • Cattle Feed, etc .

TEST REPORT

Page No. 2/2


Report No. GL/C./180813002

Opinion : Sample CONFORM to IS: 10500-2012(Permissible Limit) For the Parameters Tested.

N.M.= Not Mentioned, B.L.Q.= Below Limit Of Quantification


Date of Issue : 18/08/2018

For GUJARAT LABORATORY


Hemal Darji

Autho. Signatory

End of Report

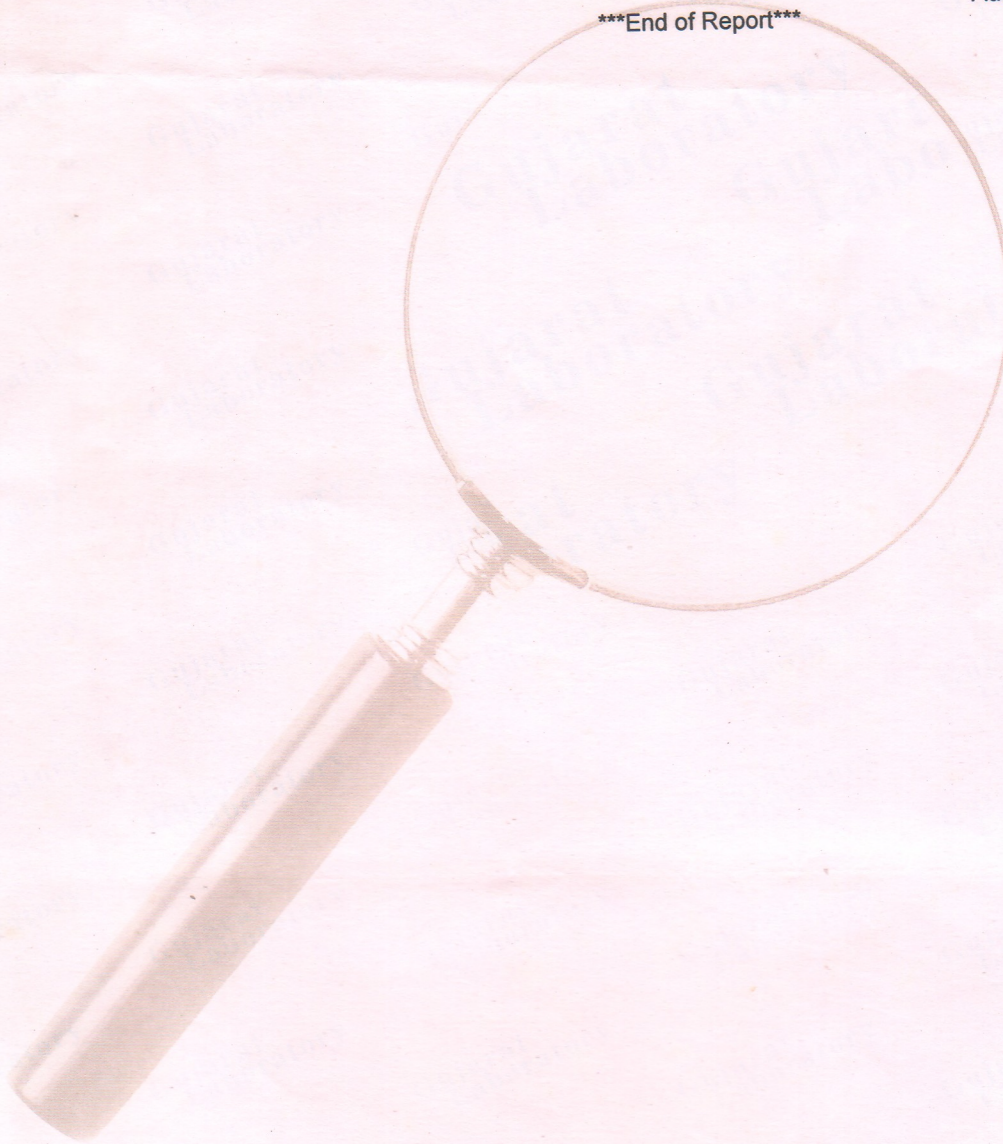

Note :

1. The Result refer only to the tested sample & applicable parameters, Endorsement of products is neither inferred nor implied.
2. Total liability of our institution is limited to the invoice amount/testing charges.
3. This report is not to be reproduced wholly or in part and cannot be used as an evidence in the court of law and should not be used in any advertising media without our special permission in writing.
4. Sample drawn & submitted by the party for analysis unless otherwise stated.
5. Gujarat Laboratory maintains strict confidentiality of all the analysis and test results and customer supplied product and will not reveal this information to third party unless required by the statutory or legal requirement.
6. Subject to Ahmedabad Jurisdiction.
7. Perishable samples will be destroyed after testing, others after three weeks from the date of issue of the report, unless otherwise agreed with the customer. Also retain sample will not be returned unless otherwise agreed in writing.
8. The sample is accepted by us subject to our general conditions of services which is displayed at reception notice board & is also available on request.
Attention is drawn to the limitation of liabilities; indemnification and jurisdictional issues etc defined therein.
9. Customer requested for the above test only.

Testing Facilities for :

Food & Agriculture Products • Water & Waste Water • Pharmaceuticals • Microbiological • Environment • Fertilizer • Soil • Cosmetic • Cattle Feed, etc .